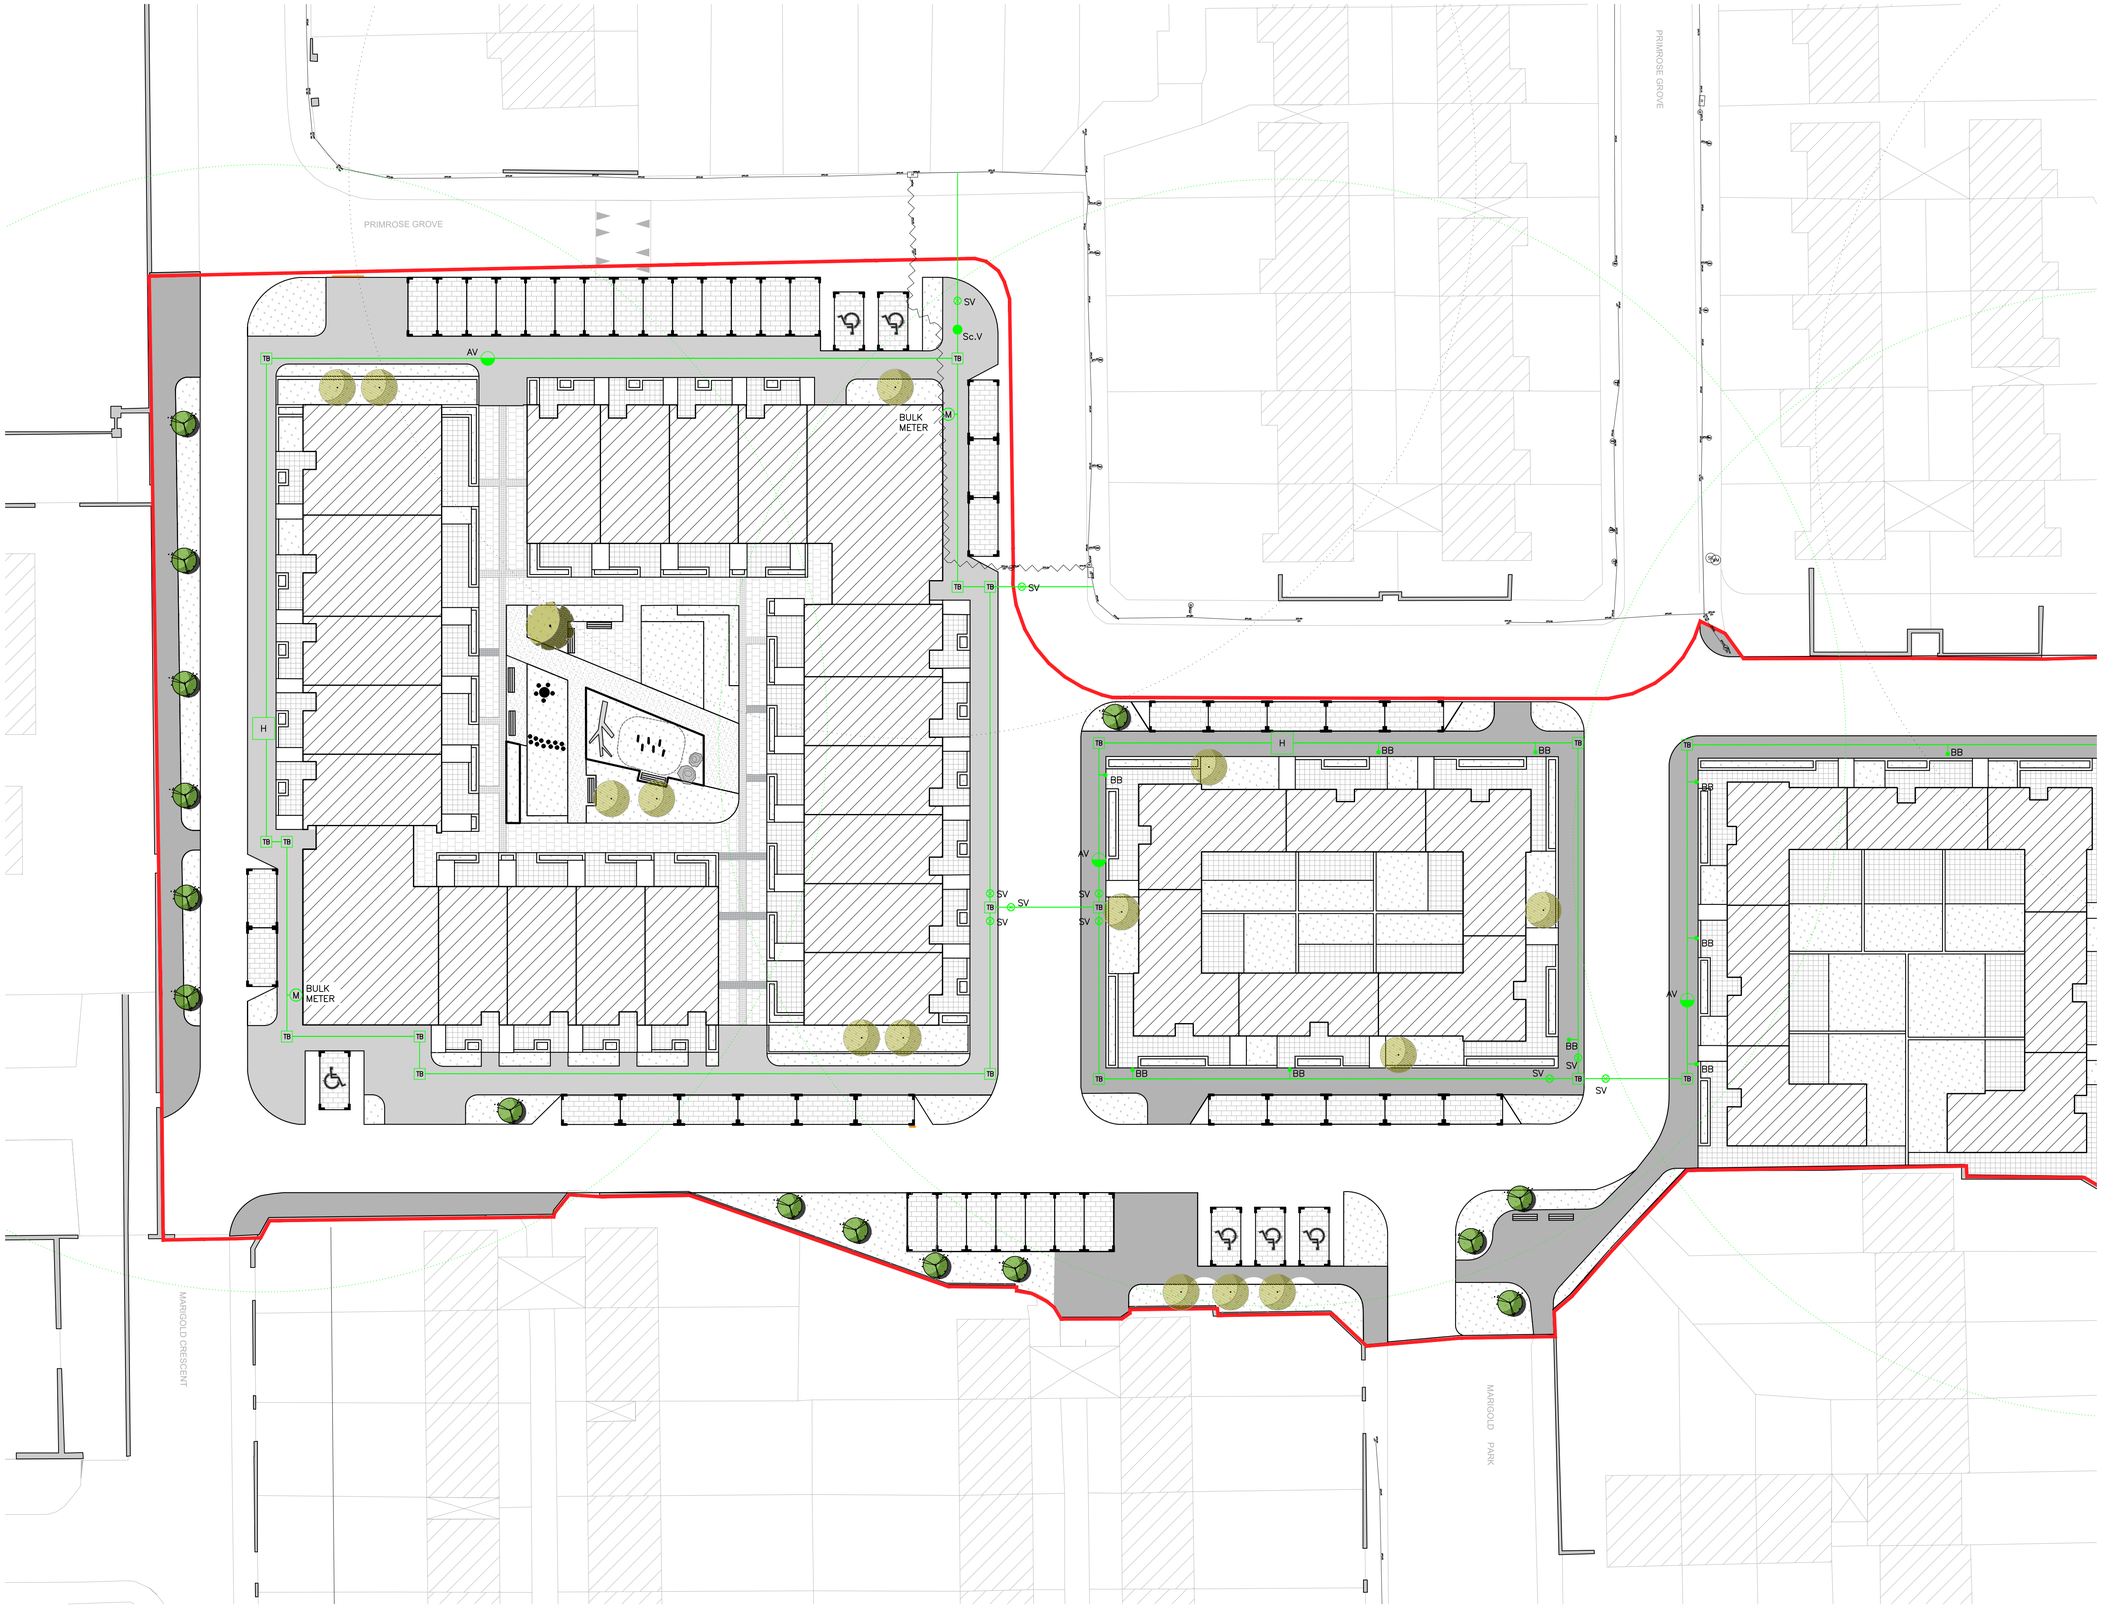

NOTES

GENERAL

1.) THESE DRAWINGS TO BE READ IN CONJUNCTION WITH ALL RELEVANT HAYES HIGGINS ENGINEERING DRAWINGS AND SPECIFICATIONS.

2.) DO NOT SCALE. USE FIGURED DIMENSIONS ONLY.

WATERMAIN LEGEND

	EXISTING WATERMAIN
	EXISTING WATERMAIN TO BE REMOVED
	PROPOSED 100mm ø HDPE
H	NEW FIRE HYDRANT IN ACCORDANCE WITH SECTION 3.16.5 OF IRISH WATER CODE OF PRACTICE (IW-CDS-5020-03)
SV	NEW SLUICE VALVE IN ACCORDANCE WITH SECTION 3.16.2 OF IRISH WATER CODE OF PRACTICE (IW-CDS-5020-03)
Sc.V	SCOUR VALVE IN ACCORDANCE WITH SECTION 3.16.4 OF IRISH WATER CODE OF PRACTICE (IW-CDS-5020-03)
AV	ONLINE AIR VALVE IN ACCORDANCE WITH SECTION 3.16.6 OF IRISH WATER CODE OF PRACTICE (IW-CDS-5020-03)
BB	BOUNDARY BOX
TB	THRUST BLOCKS TO BE PROVIDED IN ACCORDANCE WITH SECTION 4.6 OF IRISH WATER CODE OF PRACTICE (IW-CDS-5020-03)
M	BULK METER IN ACCORDANCE WITH SECTION 3.15.4 OF IRISH WATER CODE OF PRACTICE (IW-CDS-5020-03)

REV	DATE	DESCRIPTION	DWG BY	APPR. BY
P1	14.07.26	REVISED PER PRE-PART 8 SUBMISSION COMMENTS	LS	LM
P	17.04.26	ISSUED FOR PLANNING	LS	LM

ISSUED
PLANNING

CLIENT
RESPOND
SOCIAL HOUSING

PROJECT NAME
84 HOUSES
AT DARNDALE

DRAWING NAME
PROPOSED WATERMAIN
LAYOUT
SHEET 1 OF 2

PROJECT No.
25D046

DRAWING No.	REVISION
07-A	P1

SCALE	DRAWN DATE
1:250	29.01.26

CAD DRAWN BY	CHECKED BY	APPROVED BY
L.S.	L.M.	D.H.

HAYES HIGGINS PARTNERSHIP
The Glass House, 11 Coke Lane
Smithfield, Dublin 7. Tel: 01 6612321
E-mail: admin@hayeshiggins.ie
Gas House Lane, Kilkenny. Tel: (056) 7764710
Email: info@hhp.ie

A1

© HAYES HIGGINS PARTNERSHIP