



LEGEND

- LV CABLE CONTAINMENT DUCTING
- ESB MINIPILLAR
- ELECTRIC CHARGER
- ELECTRIC CHARGING PILLAR (EVP)
- ▭ LTG FEEDER PILLAR
- ▭ ELECTRIC CHARGING PILLAR (EVP)
- LV MANHOLE

External Services LV Cable Containment - A1-00
 1 : 250

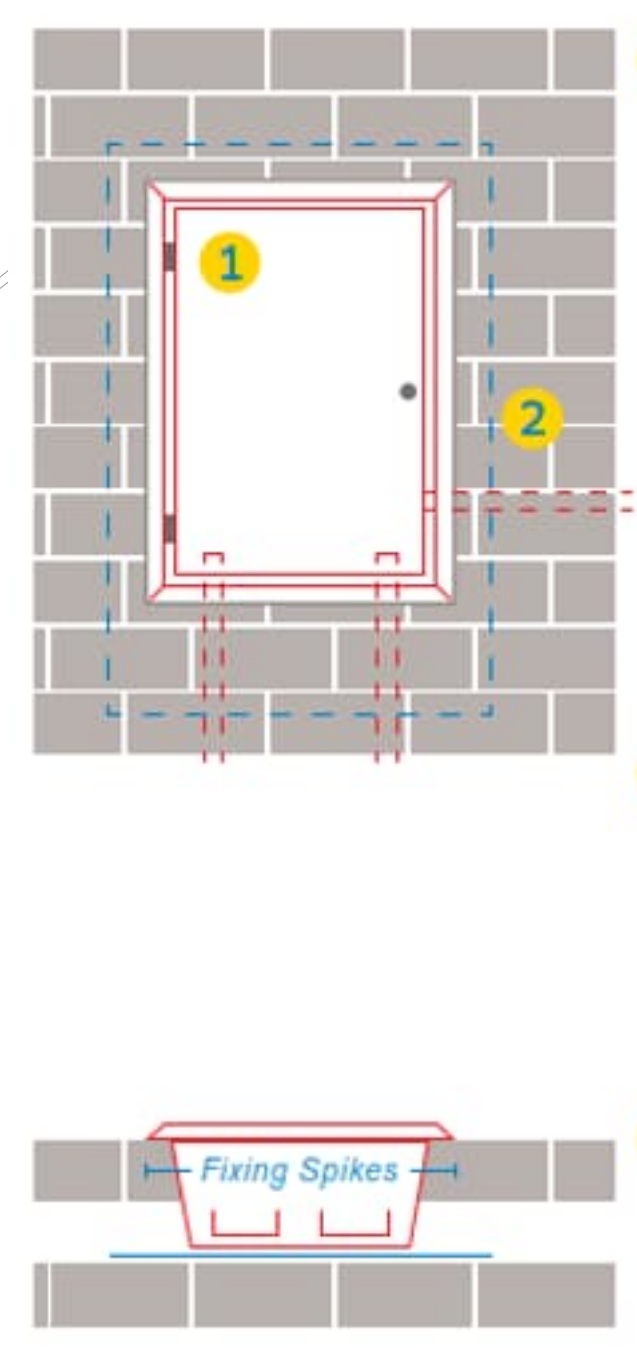

- 1** Only ESB Networks equipment to be fitted in outside meter box, except in the case of temporary builder's supplies where the customer's protection equipment must be fitted within the box on the right hand side.
- 2** Flange of cabinet to be water sealed and polythene damp proof course to be fitted by builder.
- 3** Side profile.

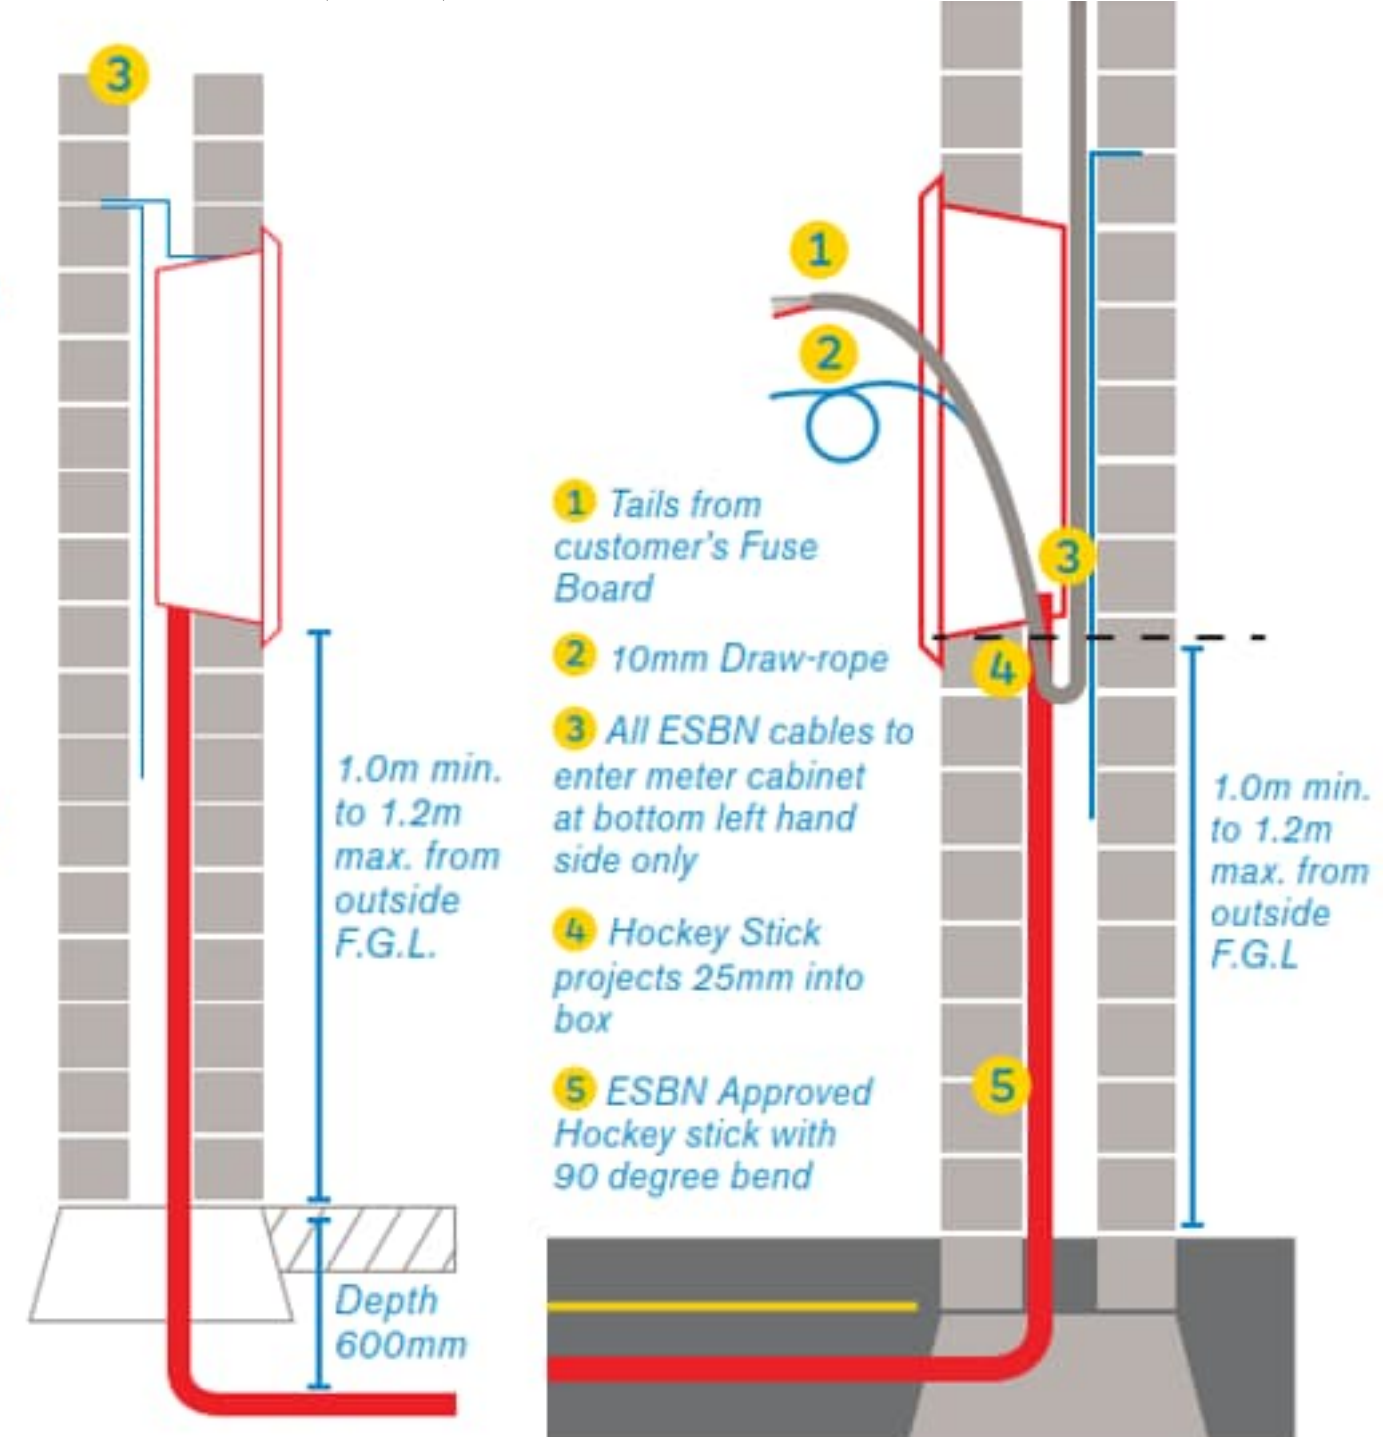

- 1** Tails from customer's Fuse Board
- 2** 10mm Draw-rope
- 3** All ESBN cables to enter meter cabinet at bottom left hand side only
- 4** Hockey Stick projects 25mm into box
- 5** ESBN Approved Hockey stick with 90 degree bend

ESB Meter Cabinet Installation
 1 : 1

Rev.	Date	Description	JB/SR/KF	Dm/Chk/Apr
P01	20250808	Suitable for Information		