


NOTES:


1. THE INSTALLATION SHALL COMPLY WITH NATIONAL IRISH STANDARDS AND DCC STANDARDS FOR PUBLIC LIGHTING.
2. THE MAIN CONTRACTOR SHALL INCLUDE FOR THE SUPPLY AND INSTALLATION OF INSPECTION CHAMBERS AS PER DCC SPECIFICATION.
3. EXTERNAL LIGHTING SHALL BE CONTROLLED BY PHOTOCELLS, WHICH MUST HAVE 36/18 LUX SWITCHING LEVELS PER PROFILE U13.

LEGEND:

- PL 100mm PVC PUBLIC LIGHTING DUCTING
- ⊠ MF-0.9 DRAW CHAMBER SI-XI
- ⊠ PUBLIC LIGHTING MICROPILLAR
- DISTRIBUTION BOARD
- A NEW ELYXE 18LS88 ECA 500mA 14W 3000K IRC70 COMPLETE WITH A 6M COLUMN
- ELYXE with ORALED 1 module


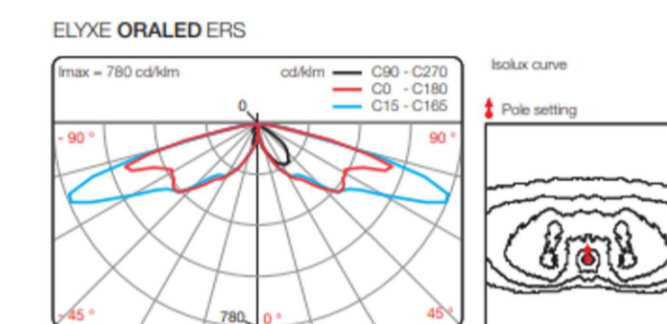


● LP NEW TWEET NEO 45W, 300mA, 3000K, LED STREET LIGHT MOUNTED ON EXISTING, EXCEPT WHERE INDICATED OTHERWISE, 8M COLUMN

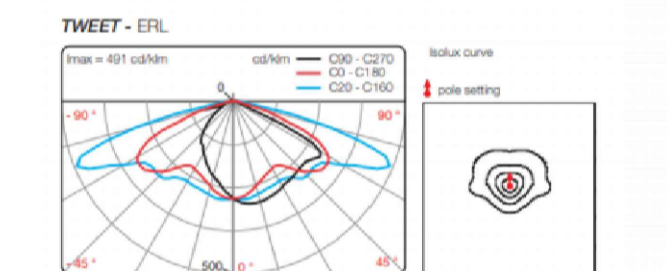

THIS LUMINAIRE TO BE SUPPLIED COMPLETE WITH 8m COLUMN, TO REPLACE EXISTING LUMINAIRE TYPE AS PER LEGEND

● B NEW TWEET NEO 14W, 500mA, 3000K, LED LUMINAIRE COMPLETE WITH A 6m COLUMN

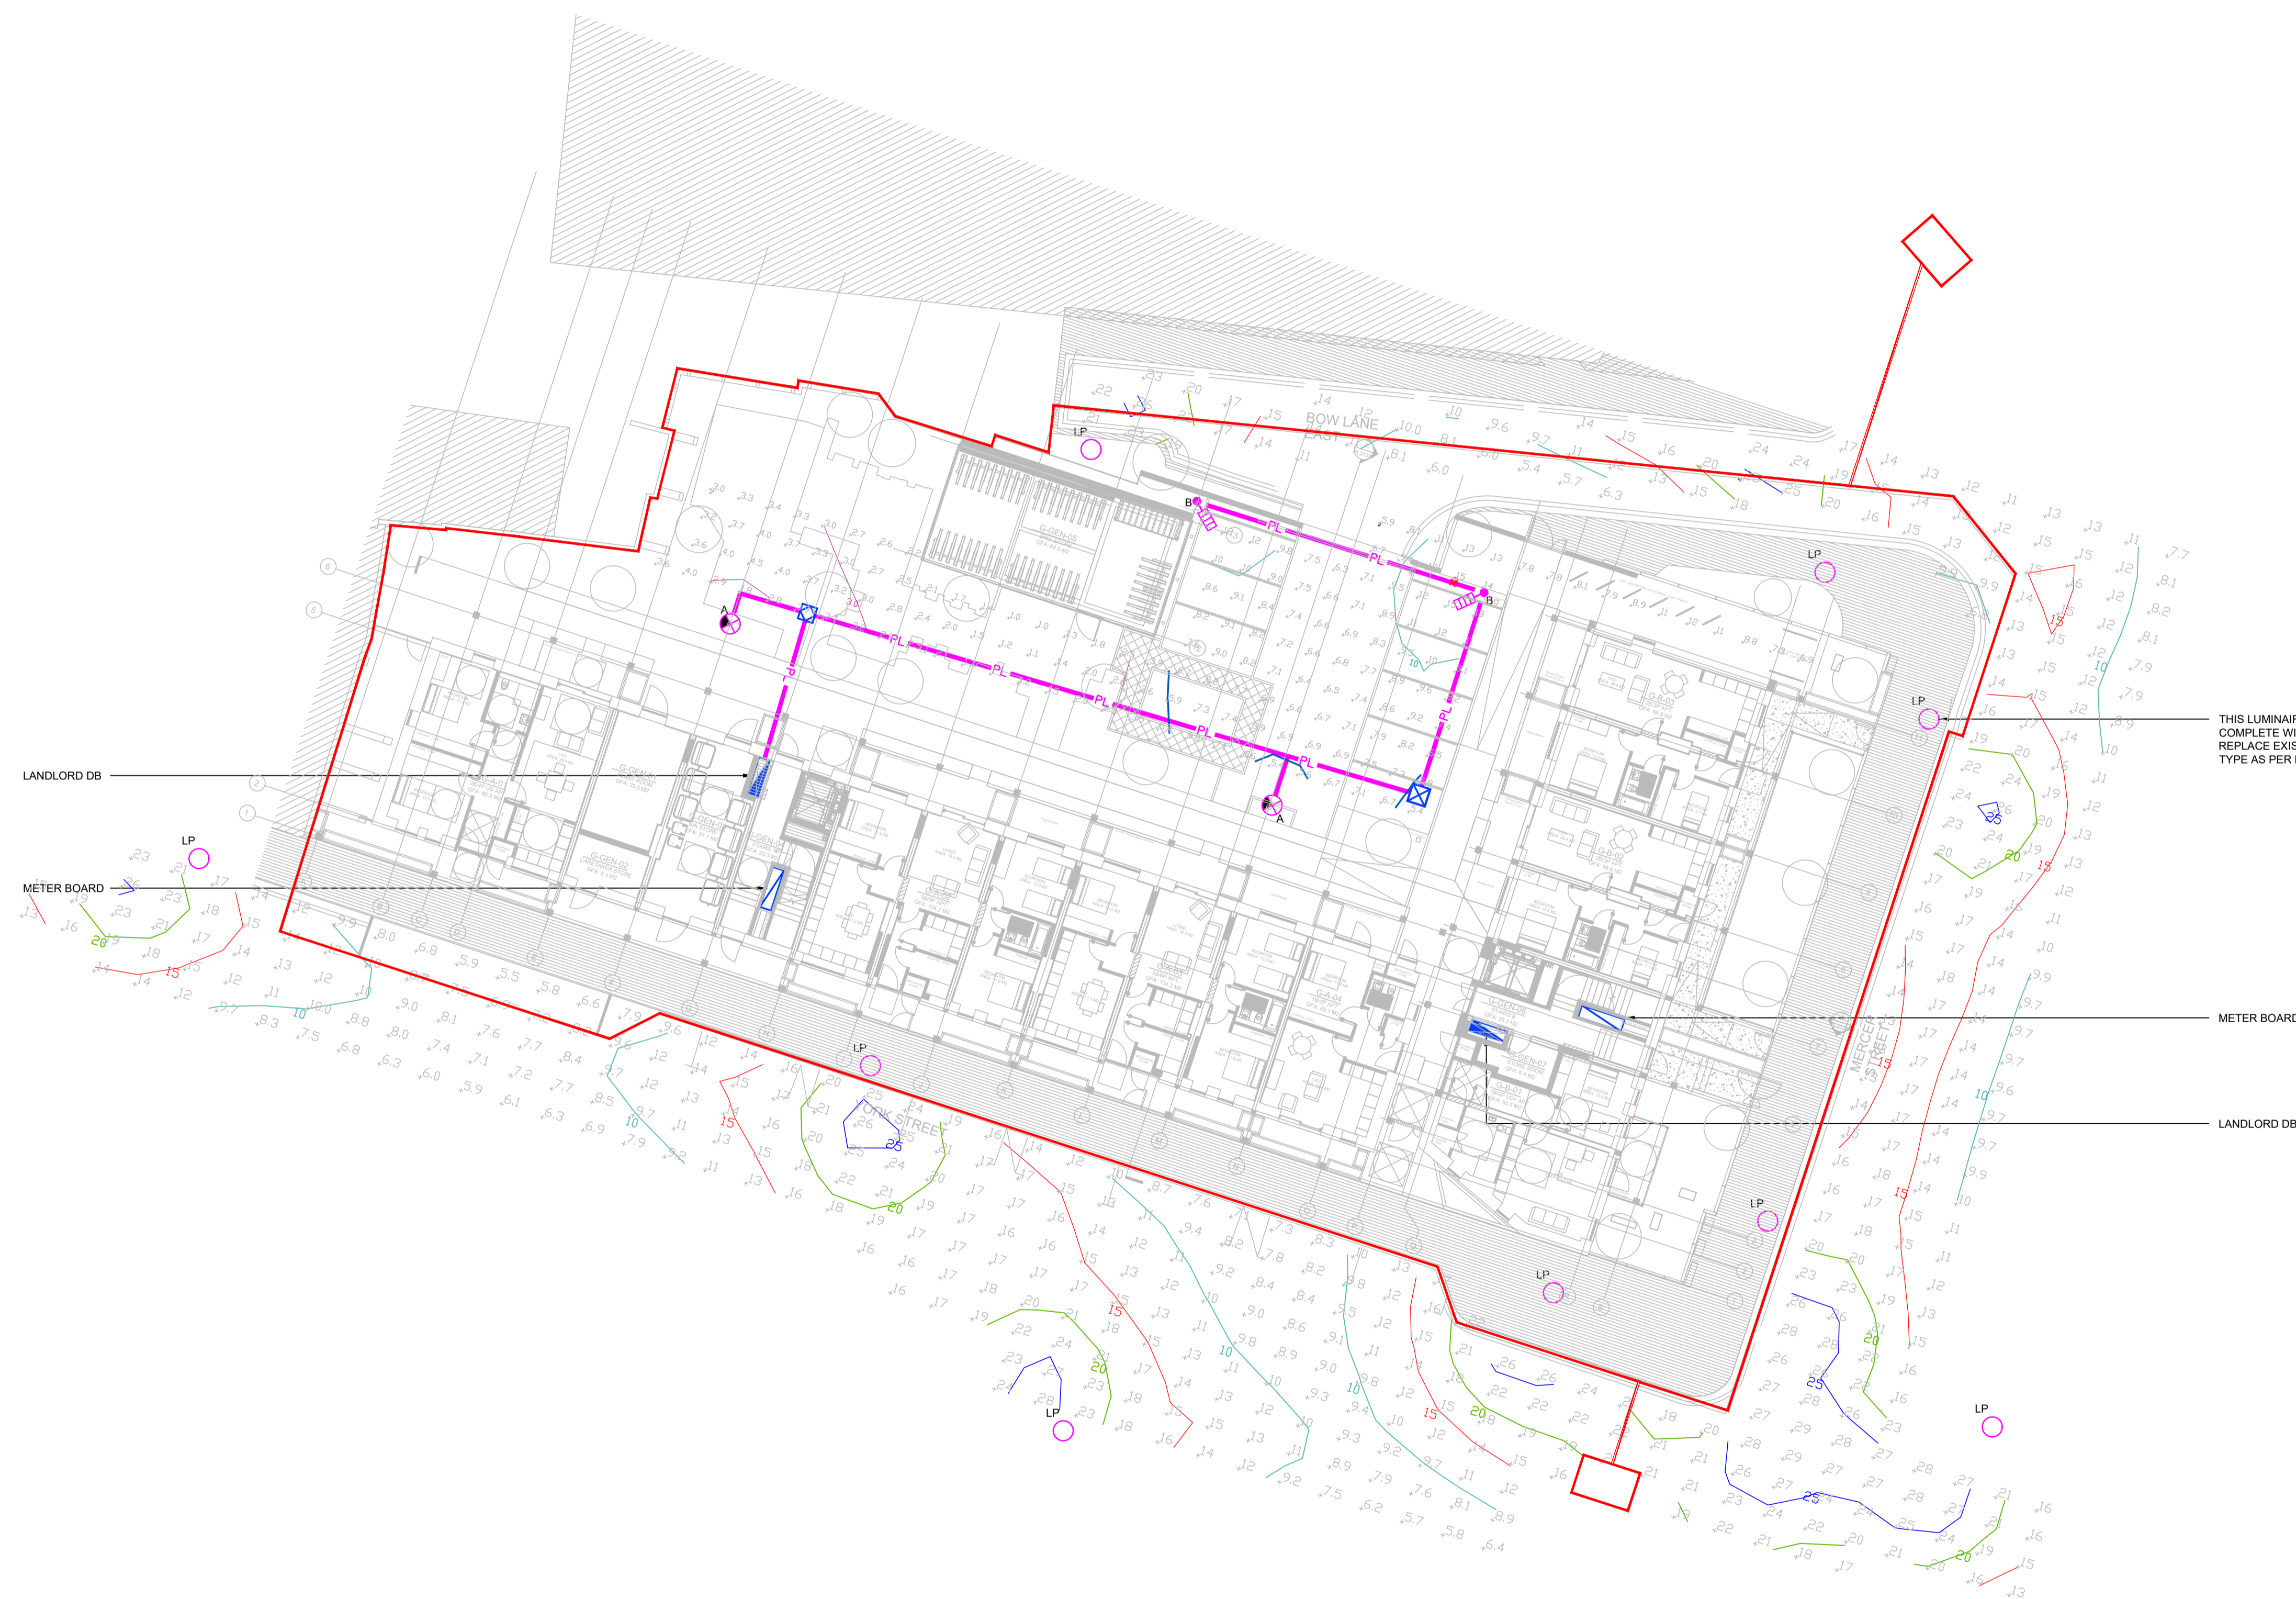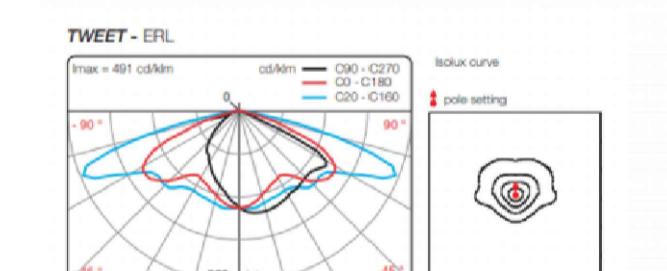

LANDLORD DB

METER BOARD

METER BOARD

LANDLORD DB

General Notes
 A. DO NOT SCALE FROM THIS DRAWING. WORK ONLY FROM FIGURED DIMENSIONS.
 B. ALL ERRORS & OMISSIONS TO BE REPORTED TO THE CONSULTING ENGINEER
 C. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ARCHITECTS AND STRUCTURAL ENGINEERS DRAWINGS.
 D. REFER TO DOCUMENT REGISTER FOR DESCRIPTION OF STATUS CODES.

Rev	Status	Date	Description	D.E.
P04	S3	04/07/25	ISSUE FOR PLANNING	D.O.R
P03	S3	23/01/25	ISSUE FOR PLANNING	D.D.
P02	S3	06/11/24	ISSUE FOR PLANNING	D.D.
P01	S3	27/09/24	ISSUE FOR PLANNING	D.D.

Client
DUBLIN COUNTY COUNCIL

Project Title
GLOVER COURT DEVELOPMENT

Drawing Title
PROPOSED SITE LIGHTING SERVICES

Dublin 01 4872300
 Cork 021 2375080
 Roscommon 090 6602380
 Website www.varming.ie

Engineering for the Future

Varming
 Consulting Engineers Ltd.

Revision	Project Drawing Reference		
P04	23681-VCE-XX-XX-DR-E-1002		
S3	Varming Project Number 23681		
Date	Checked By	Drawn By	Scale
NOV '23	D.D.	A.W.	1:200@A1